

METER BOX AND CAST IRON FRAME & POLYMER COVER, IN ACCORDANCE WITH THE APPROVED PRODUCTS LIST. INSTALL LEVEL WITH FINISHED GRADE.

WOOD STAKE TO MARK END OF THE LINE

EXTEND TRACER WIRE A MIN. OF 4" ABOVE THE ANGLE VALVE


YOKE AND ANGLE VALVES (2)

PLACE METER BOX ON A MINIMUM OF ONE ROW OF BRICK. ADDITIONAL ROWS OF BRICK MAY BE REQUIRED TO MATCH FINISHED GRADE AND ACHIEVE 24" DEPTH.

CAP WITH SUITABLE PLUG AT 12"-18" FROM BOX OR CONNECT TO SERVICE LINE

SEE DETAIL W-6

6" MIN. #68 STONE (SANDSTONE REQUIRED WHERE CONTACT WITH COPPER IS POSSIBLE).

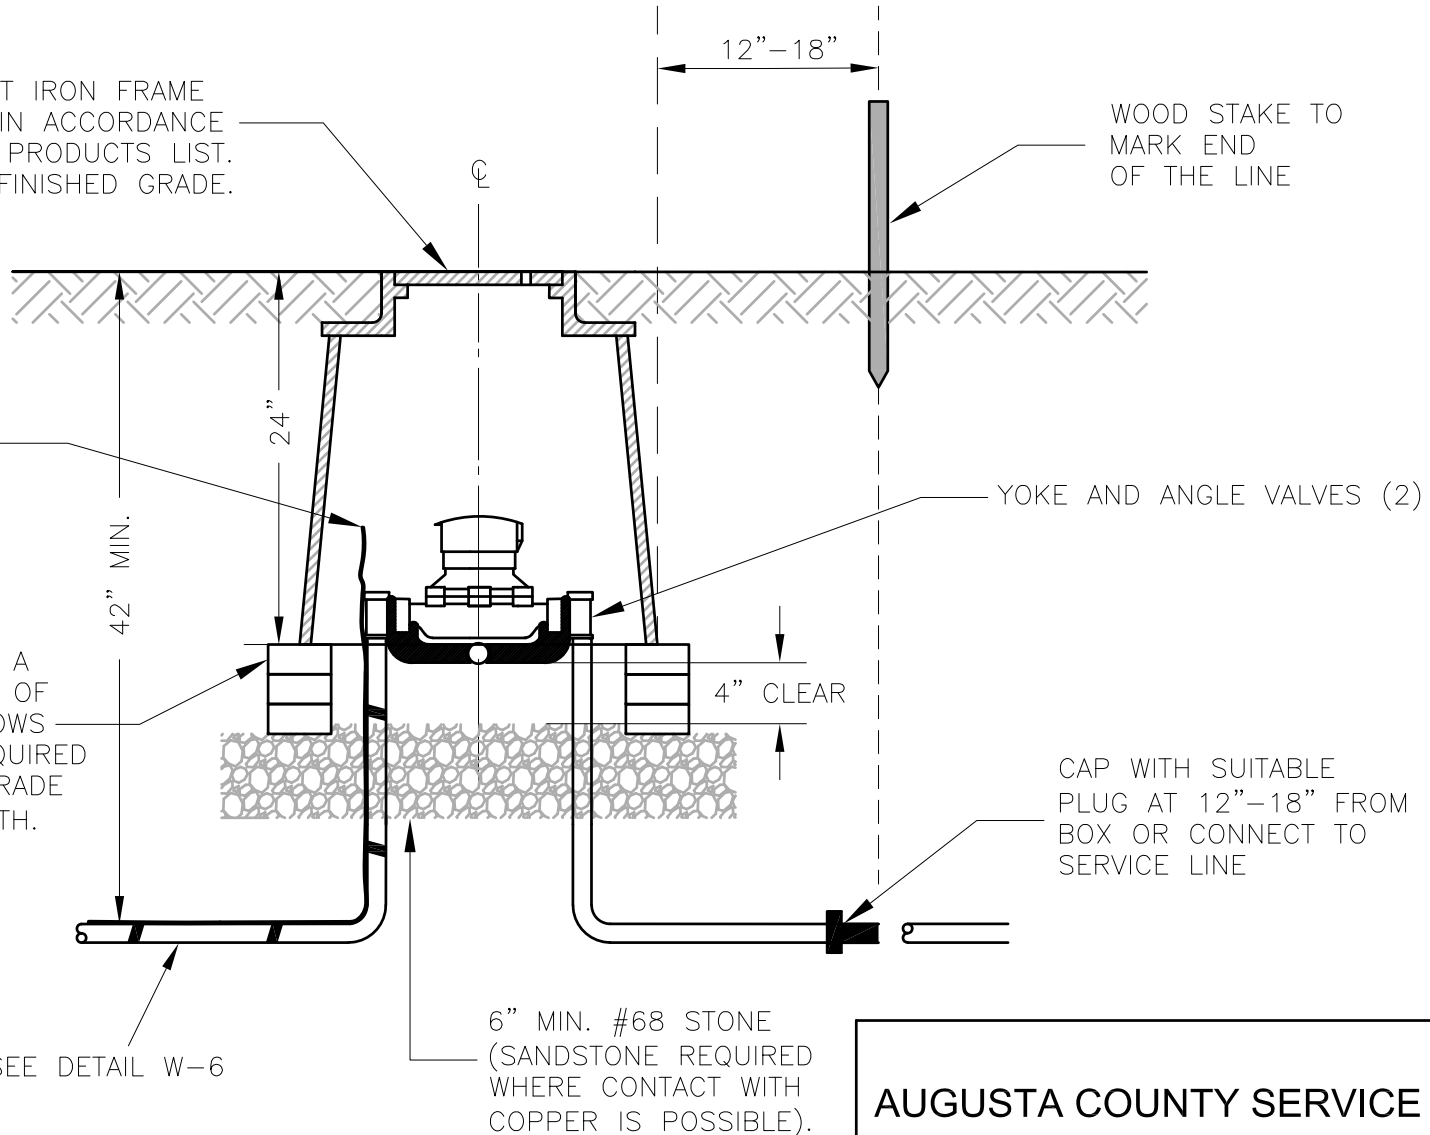

METER SIZE	YOKE BAR WITH EXPANDER WHEEL
5/8"	5/8"
3/4"	5/8" X 3/4"
1"	1"

**AUGUSTA COUNTY SERVICE AUTHORITY
VERONA, VIRGINIA**

SCALE: NTS

DRAWN BY: ACSA

DATE: FEB. 1996

REVISED: FEB. 2021

**TYPICAL WATER SERVICE
CONNECTION 5/8", 3/4" & 1"**

DRAWING NUMBER: W-7A

PAGE: 1 OF 1