

Bid Addendum

Addendum No. 4 for Augusta Water Middle River Regional WWTP Secondary Clarifier No. 3 Grout Topping Replacement, Wiley|Wilson Comm. No. 222110.10.

Addendum Date: March 5, 2024
To: All Bidding Contractors
From: Wiley|Wilson
Lynchburg, VA

This Addendum contains 1 pages and listed attachments and forms a part of the bidding documents and modifies the Project Manual dated February 5, 2024 and Drawings dated November 1, 2022, as noted below. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject bidder to disqualification.


QUESTIONS FROM BIDDERS

Question 1: How thick is the existing grout topping?

Response: Augusta Water understands the existing grout topping thickness to be generally 2-inches. For estimating purposes, Bidders should assume demolition of a maximum 2.5-inch thick grout topping as an average for the entire grout topping.

End of Addendum No. 4

Wiley|Wilson

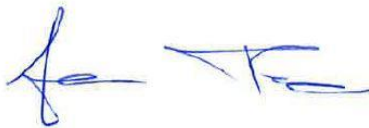

Aaron Tice, P.E.